


Flow Chart with Operation Specification for PA-8-12A

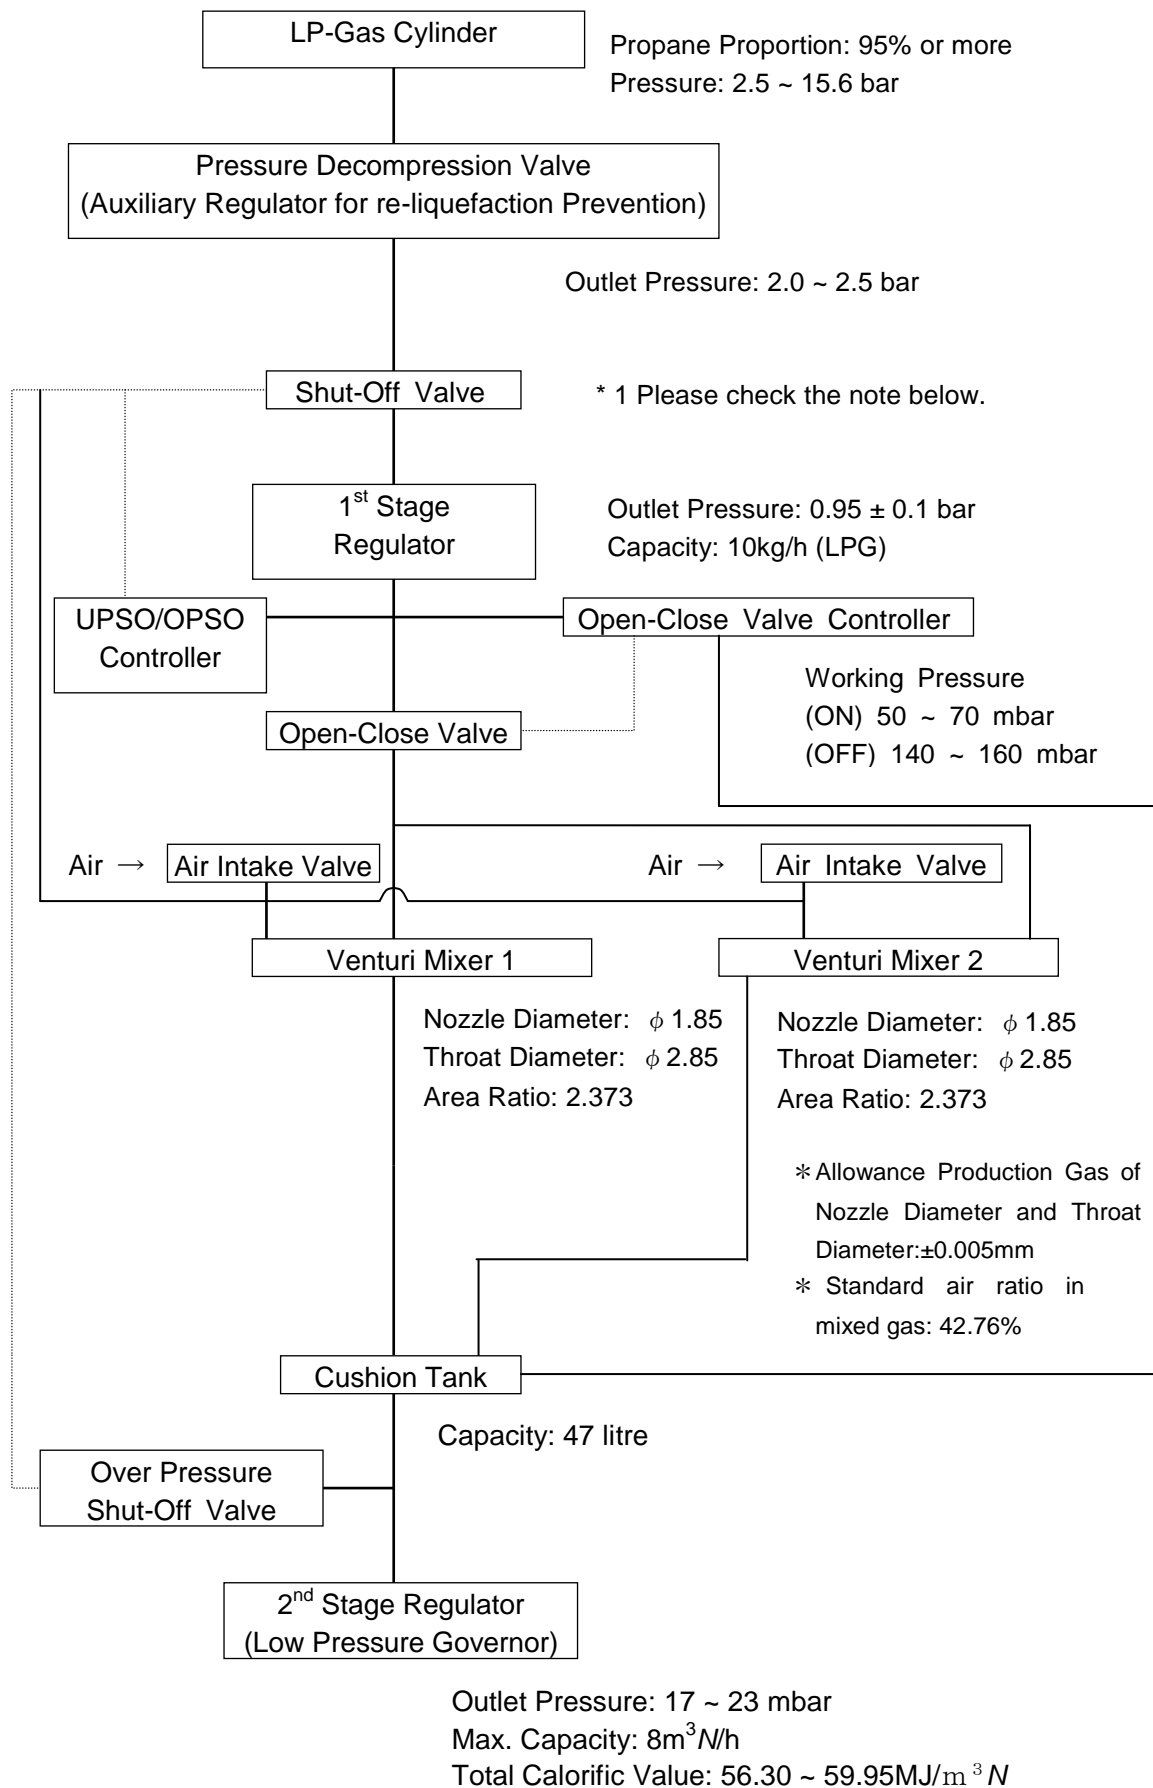

*1 Working Pressure for Shut-Off Valve

Shut-Off Pressure for Negative Pressure (Abnormally Low Volume of Air Suction)

-15mbar \pm 5mbar

UPSO Shut-Off Pressure (Abnormally Low Supply Pressure at Nozzle)

500 \pm 200 mbar

OPSO Shut-Off Pressure (Abnormally Low Supply Pressure at Nozzle)

1.5bar \pm 200 mbar

Over Pressure Shut-Off Valve (Abnormally High Pressure in Cushion Tank)

230 mbar \pm 30mbar